
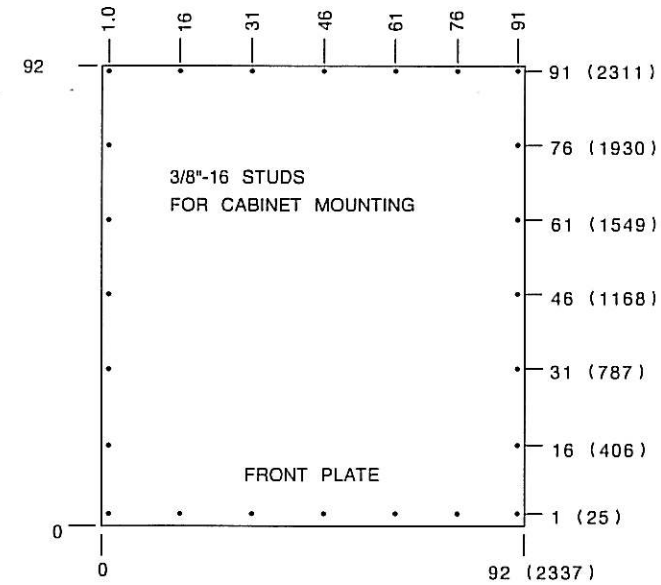
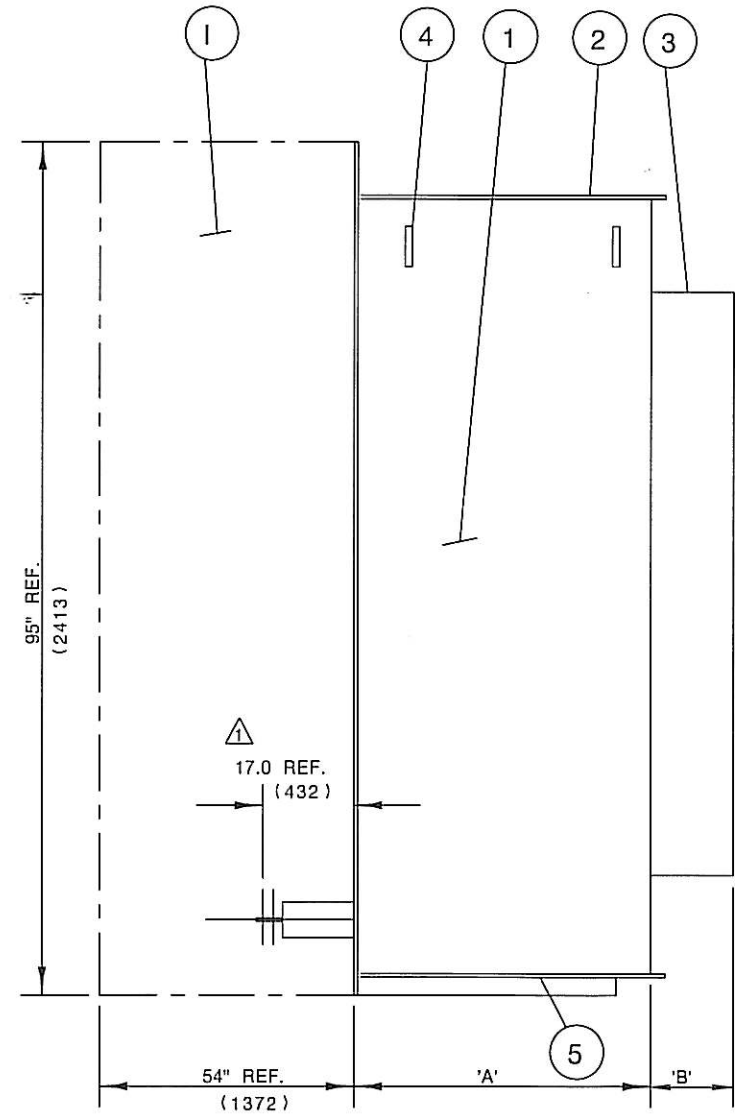


KVA	TOTAL MASS (INCL. CAB.) LBS. (KG)	OIL QTY. GALS (L)	RAD SECS.	'A' IN (MM)	'B' IN (MM)	'C' IN (MM)	LV BUSHING SPADE AS PER C2-82 FIG.3
500	9800 LBS. (4455 KG)	434 GALS (1973 L)	7	30.5 (775)	18.5 (470)	72" (1829)	III 4 HOLE
750	11,000 LBS (5000 KG)	487 GALS (2214 L)	12	34.5 (876)	16.5" (420)	72" (1829)	III 4 HOLE
1000	12,700 LBS (5773 KG)	537 GALS (2441 L)	14	38.5" (978)	18.5 (470)	72" (1829)	III 4 HOLE
1500	13,800 LBS (6273 KG)	570 GALS (2591 L)	27	40.5 (1028)	22.0 (559)	72" (1829)	III 4 HOLE
2000	16,700 LBS (7591 KG)	641 GALS (2914 L)	30	42.5 (1080)	23.5 (597)	72" (1829)	IV 4 HOLE
2500	18,000 LBS (8182 KG)	686 GALS (3119 L)	48	44.5 (1130)	27.0 (686)	72" (1829)	V 6 HOLE
3000	19,500 LBS (8864 KG)	692 GALS (3146 L)	68	44.5 (1130)	36.0 (914)	72" (1829)	8 HOLE

ITEM	DESCRIPTION	REVISIONS
1	TLO 15 GA. CABINET/SWITCH/FUSE/COMP. TO BE SUPPLIED BY MARKHAM ELECTRIC	REDRAWN, 17" WAS 13 JAN.10/94 RD
1	TRANSFORMER TANK	
2	WELDED COVER	
3	RADIATOR	
4	LIFTING LUG	
5	JACKING AREA	
6	HV BUSHING (2 HOLE SPADE)	
7	LV BUSHING SPADE (SEE TABLE)	
8	GROUND STRAP (X0)	
9	OIL LEVEL GAUGE	
10	PRESSURE RELIEF DEVICE	
11	OIL FILL PLUG	
12	OIL DRAIN VALVE C/W SAMPLER	
13	NAMEPLATE	
14	TAP SWITCH	
15	GROUNDING PAD	
16	GROUND STRAP (H0)	
17	THERMOMETER WELL QUALITROL 167-50-3D	
18		
19		
20		

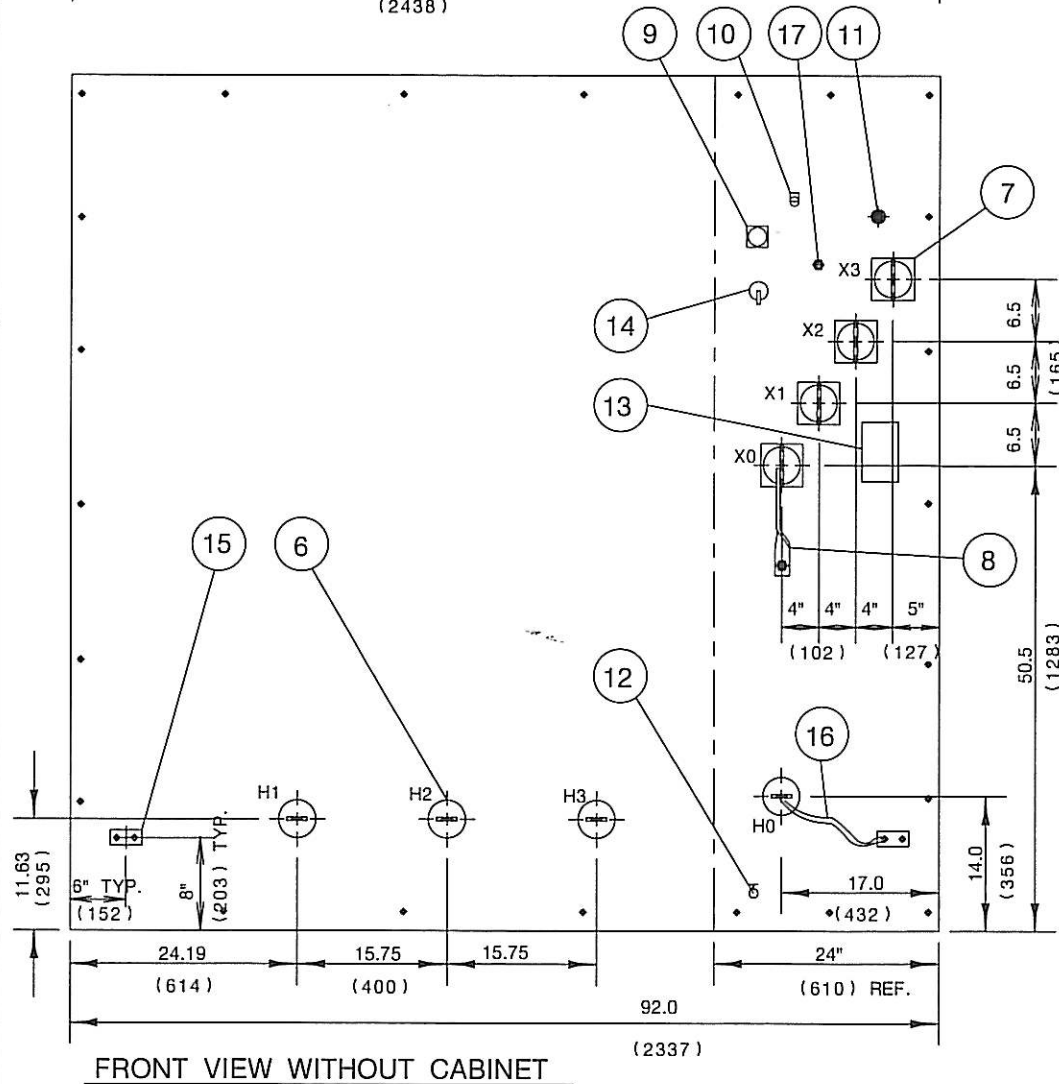

HV 27600Y/16000
LV 600Y/347

DIMENSIONS AND TOLERANCES ARE IN INCHES		CARTE INTERNATIONAL INC. WINNIPEG, CANADA	
SPEC.: C227.2 & MARKHAM	TITLE: 3PH. PRIMARY SERVICE ENTRANCE TRANSFORMER 25KV		
MAT'L: WEIGHT OF CABINET & SWITCH ASSEMBLY 2000 LBS.	DWG. RD DATE 94/01/10	CH'KD.	APP'D.
	SCALE NTS	PR 4262	B 00